Newark Liberty International Airport – Infrastructure Renewal Program – New Electrical Substation for Terminal B and Replacement of Electrical Substation & Chillers Serving Central Heating & Refrigeration Plant – Project Authorization

Committee on Capital Programs, Execution & Asset Management

November 15, 2012

Substation in the Central Terminal Area

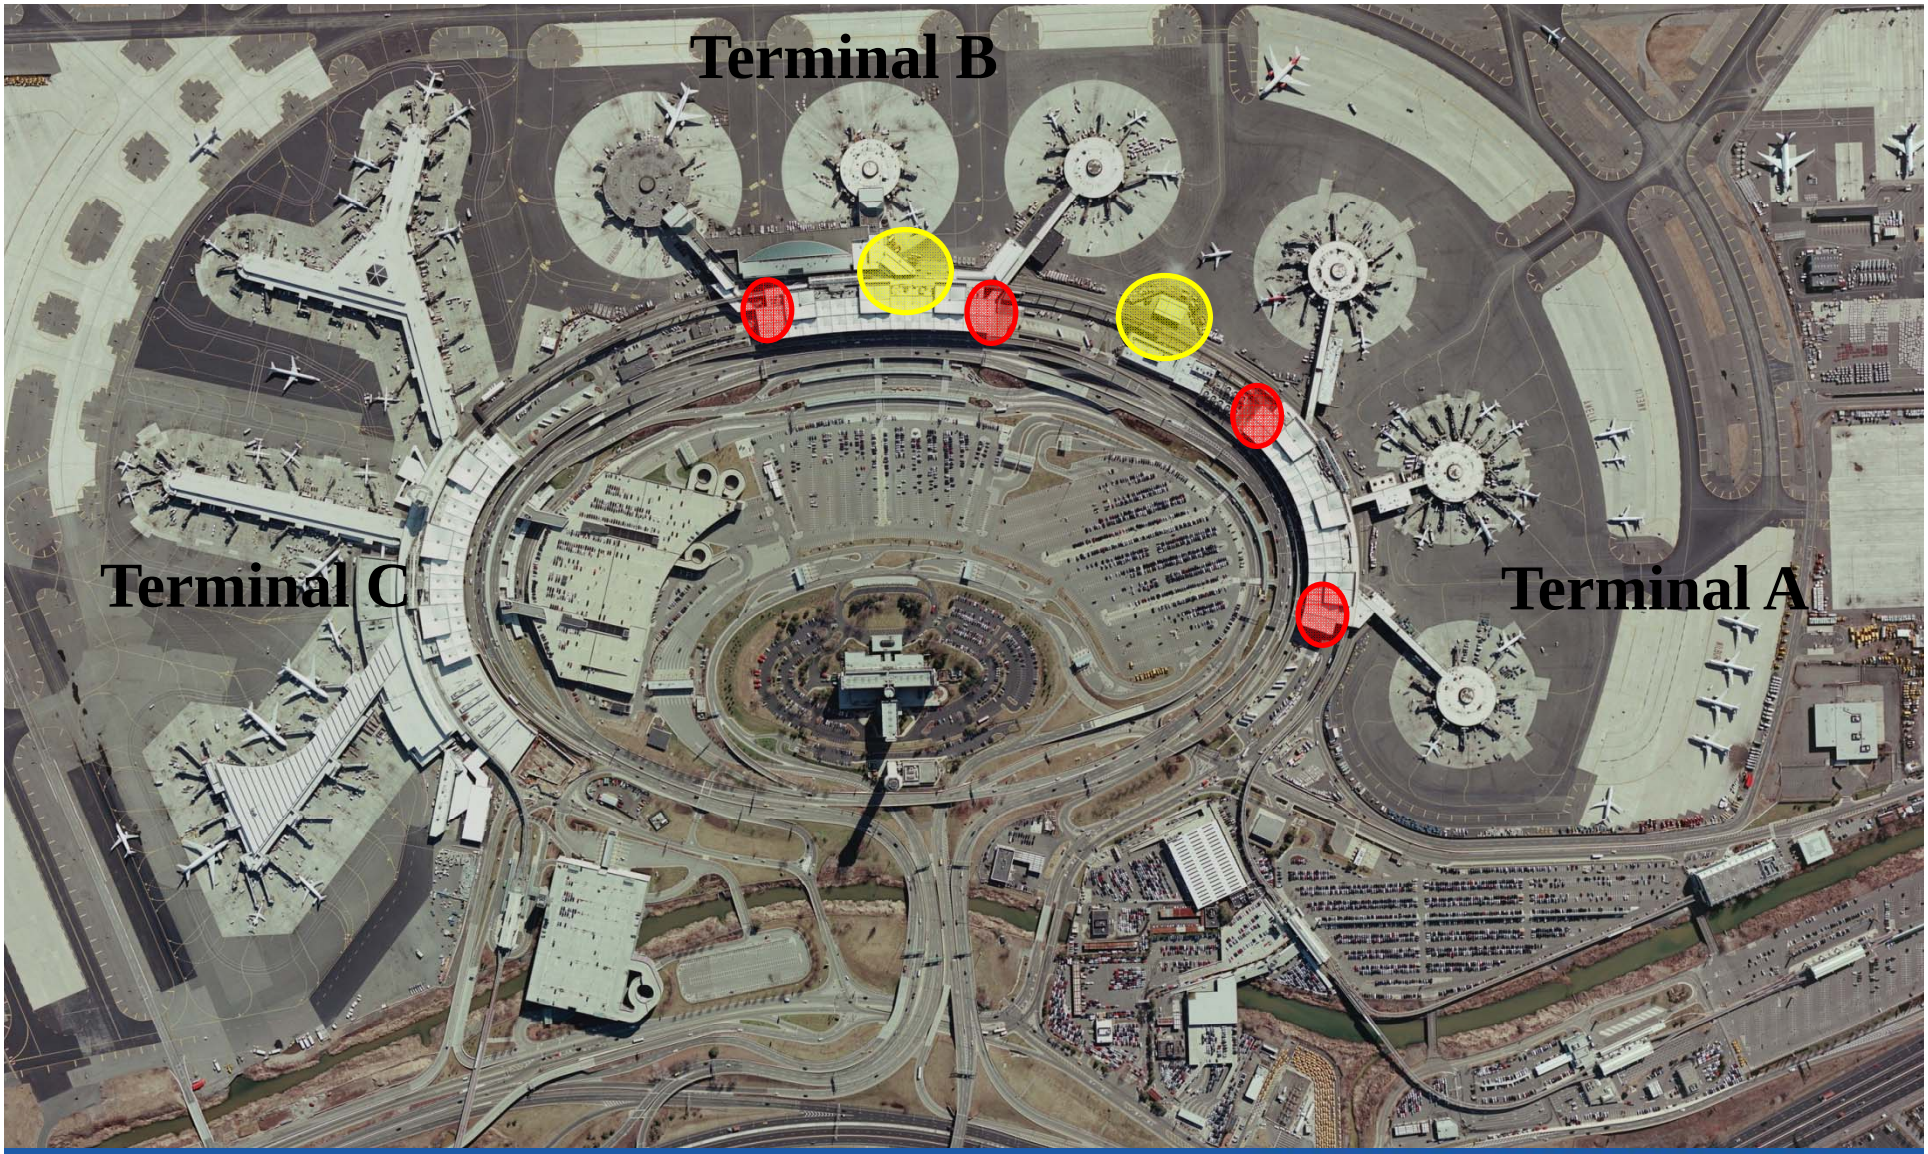

Terminal B Fourth Electrical Substation

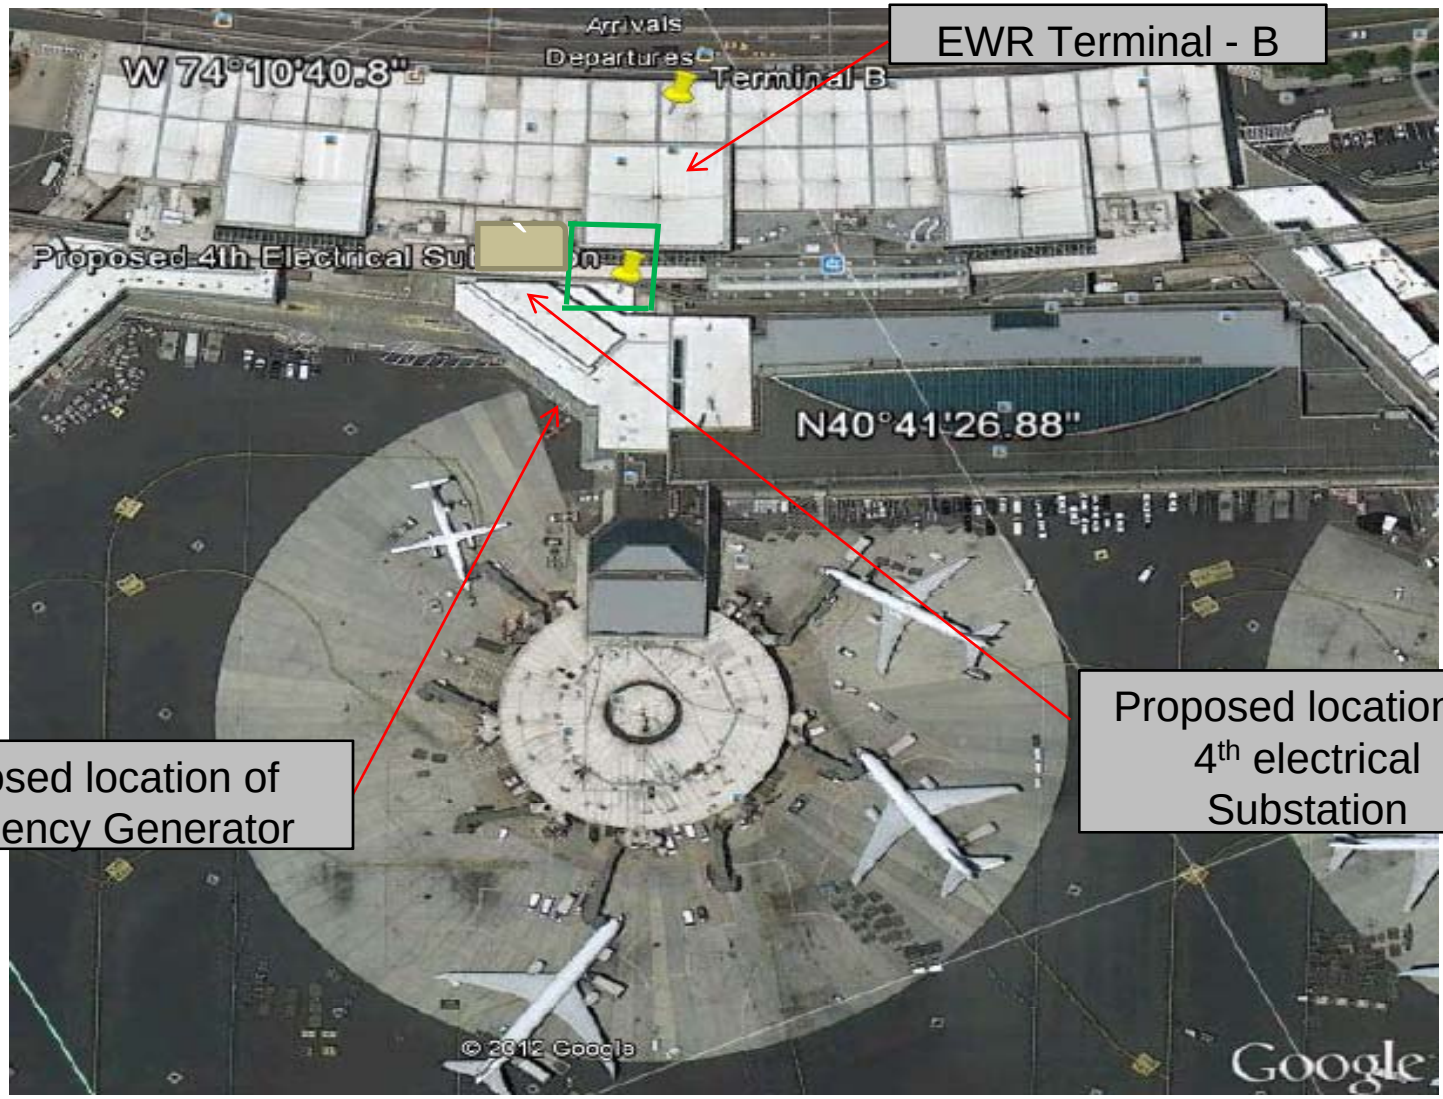

Replacement of North Electrical Substation & Chiller Upgrades for CHRP

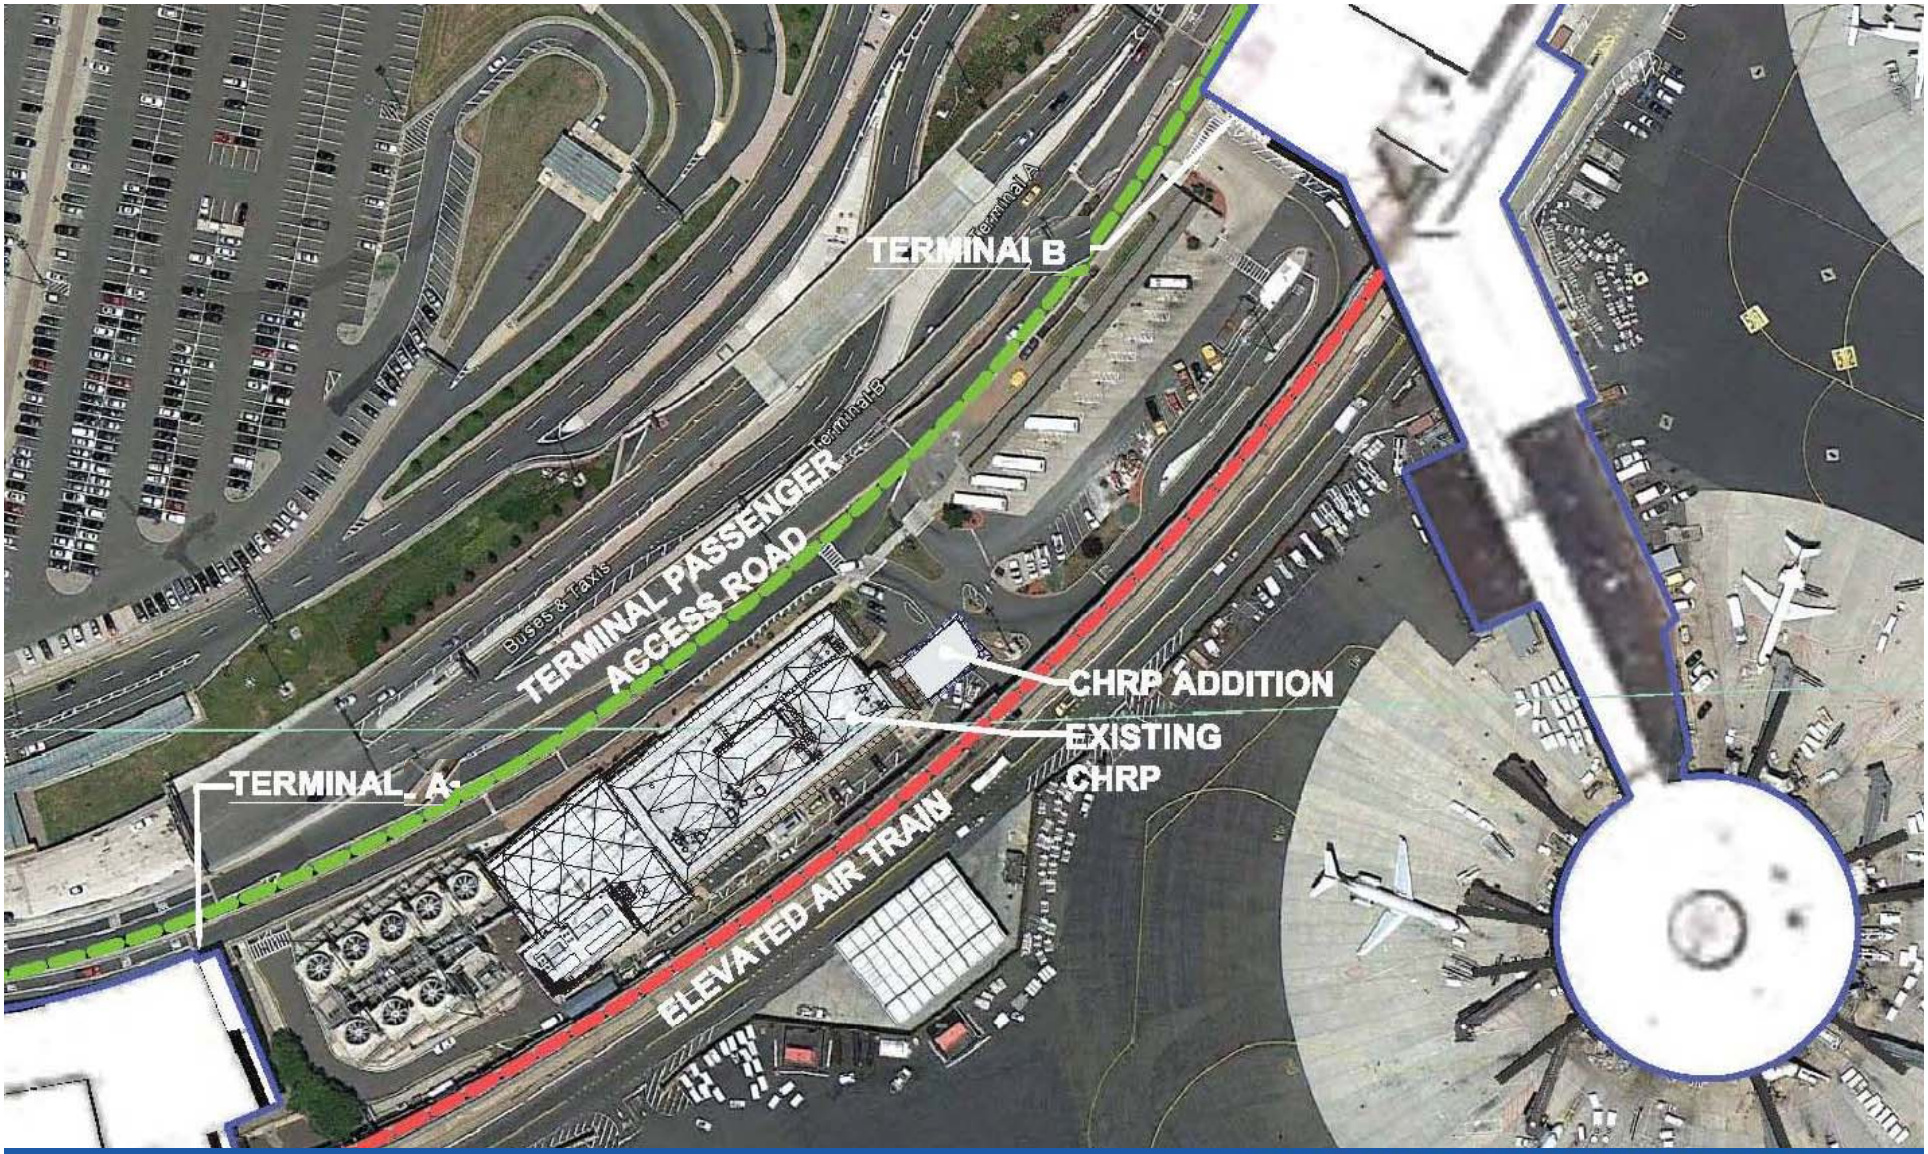

Economic Impact

- ✈280 total job years
- ✈$17 Million in wages
- ✈$100 Million in Economic Activity

Cost and Schedule

✈Project authorizations	$58.41 Million
✈Construction contract	$29.75 Million
✈Contract with PSE&G	$ 3.10 Million
✈Amount recoverable	100%